



**JAY R. SMITH MFG. CO.**  
 DIVISION OF SMITH INDUSTRIES, INC.  
 POST OFFICE BOX 3237  
 MONTGOMERY, ALABAMA 36109-0237 (USA)  
 TEL: 334-277-8520 FAX: 334-272-7396 www.jrsmith.com




LOCATION

PM 2729A

## INSTALLATION INSTRUCTIONS FLUSHING TYPE DRAINS


**NOTE:**  
 Back siphonage protection such as a vacuum breaker should be installed to protect the potable water supply.

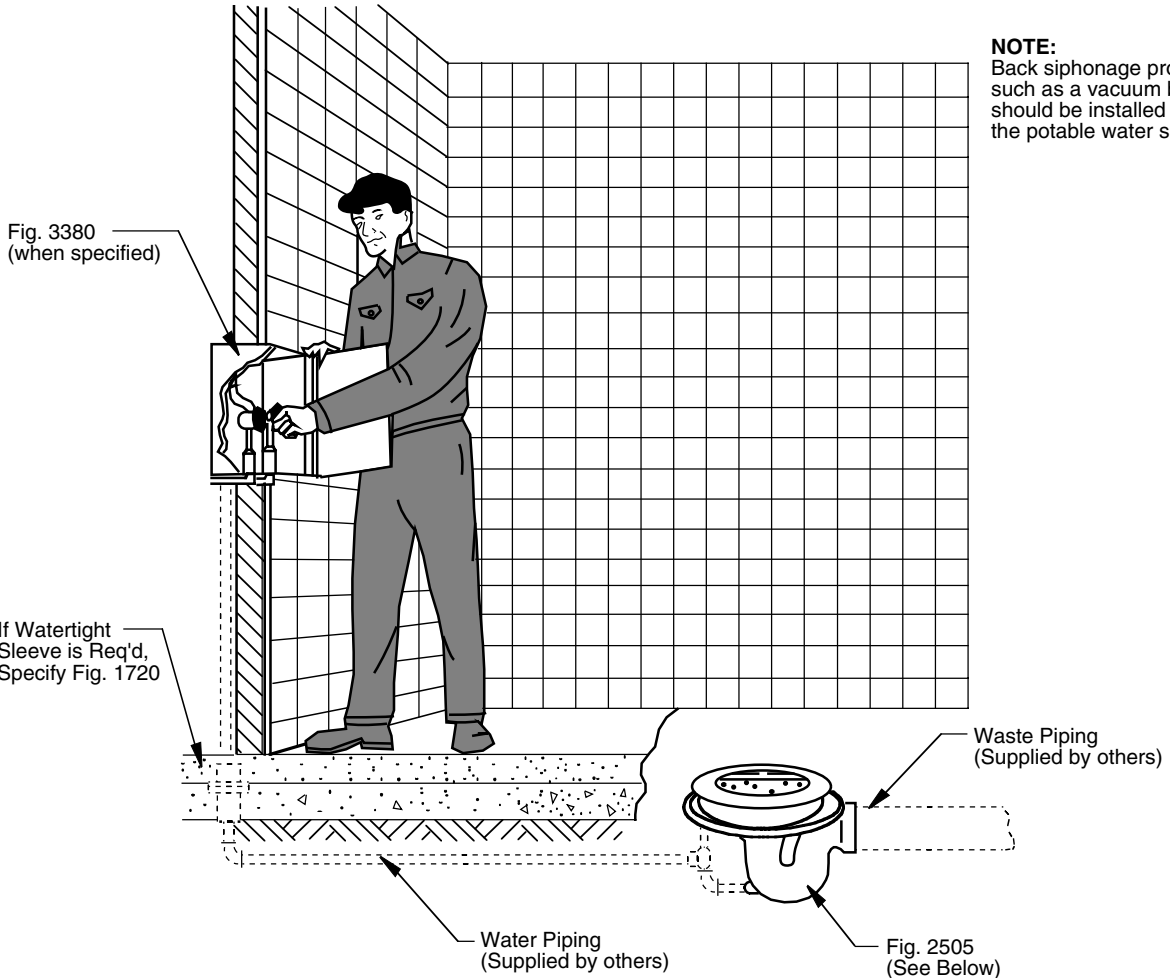

**Flushing Drains:** These are particularly suitable for installation where it is deemed desirable to periodically wash down the walls of the receptor or to provide a means of flushing solids through a trap. The flushing rim type has a full circle flushing chamber underneath the top section of the drain which permits effective scouring of the receptor walls during the flushing cycle. Trap flushing connections are very desirable where the drains are used as water closets. Flushing type drains should be specified wherever it is desired to supply an easy, quick and efficient means of maintaining sanitation and cleanliness. They are particularly suitable in hospital operating rooms, cystoscopic and animal rooms; also, industrial or university laboratories, zoos, and any other location where used as a water closet such as prisons and mental institutions.

**OPTIONAL GRATES**

- Hinged Perforated Grate ..... 2505
- Loose Set Wide Bar Grate..... 2506
- Integral Grate and Rim ..... 2507

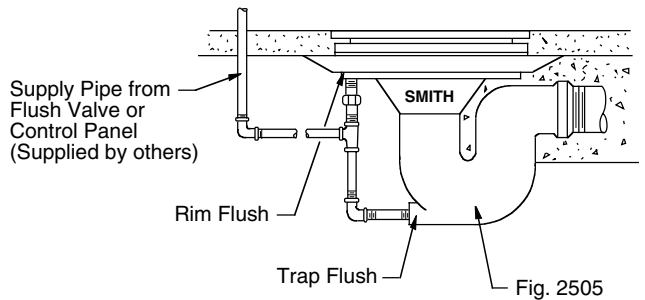

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

DRAWING NUMBER  
PM 2729A

SIZE  
**A**

SCALE:  
NONE

DATE:  
5-23-84

APPROVED BY:  
SJM

CHECKED BY:  
SJM

DRAWN BY:  
PJ

**2505, 06, 07**

FIGURE NUMBER

A	1-17-95	Updated	CMB	
REV.	DATE	DESCRIPTION	BY	CKD. BY

WEIGHT POUNDS	VOLUME CUBIC FEET

**FIGURE NUMBER**  
**2505, 06, 07**