



LOCATION

NON-FREEZE POST HYDRANT

FUNCTION: Used where an above ground water outlet is required in areas which are subject to freezing temperatures. Freezing is prevented by burying the valve housing below the frost line and draining water from the casing after shut-off.


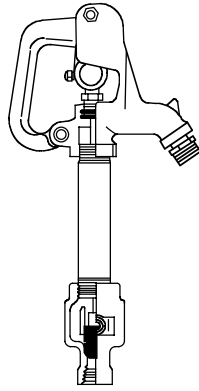


FIG. 5909

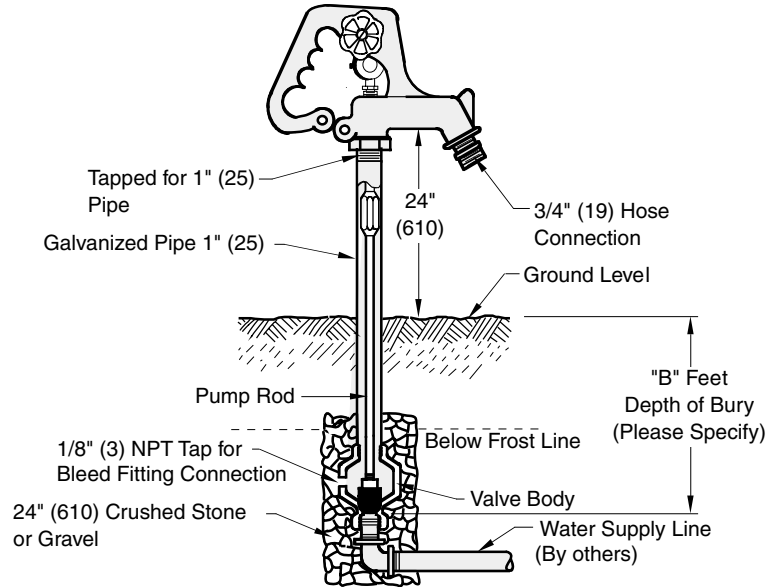


B (Depth of Bury) = 02(610), 03(915), 04(1220), 05(1525) or 06(1830) Feet

REGULARLY FURNISHED:
 Non-Freeze Post Hydrant with Galvanized Casing and Adjustable Flow Wheel Lock Handle.

VARIATIONS:

- Vacuum Breaker -H
- 1"(25) Hose Connection -HC1
- 1"(25) Female Inlet Connection -MF-1

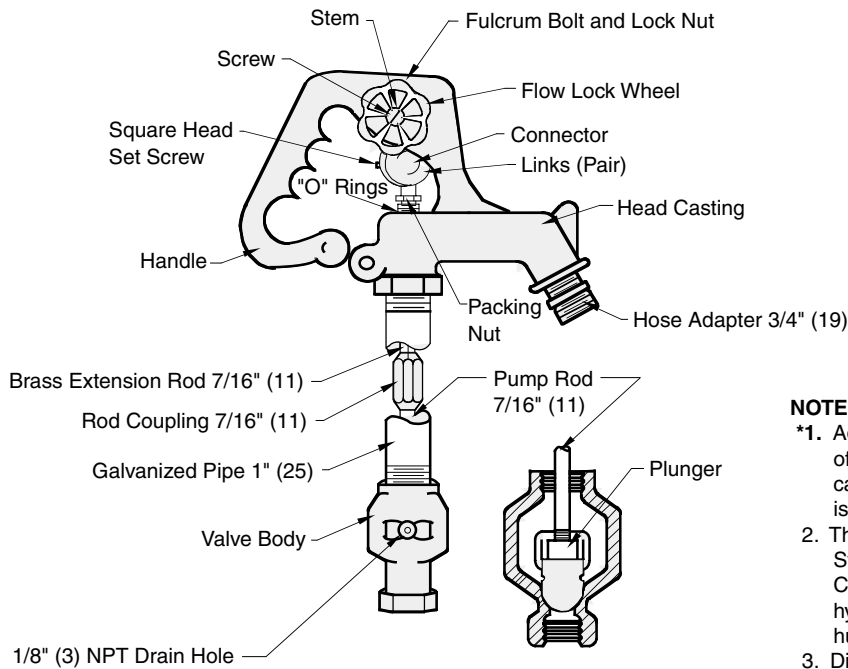

NOTE:

- *1. Addition of vacuum breaker will not allow draining of the casing. Smith is not responsible for any casings that burst or related incidents if the hydrant is supplied with a vacuum breaker.
2. The AB1953, California Lead Law, and NSF/ANSI Standard 61-2008 - Drinking Water System Components are not applicable to Jay R. Smith hydrants as they do not convey/dispense water for human consumption through drinking or cooking.
3. Dimensions shown in parentheses are in millimeters.

DRAWING NUMBER
S5909

SIZE
A

SCALE:
NONE

DATE:
9-25-90

APPROVED BY:
CR

CHECKED BY:
BS

DRAWN BY:
EMB

5909

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

REV.	DATE	DESCRIPTION	BY	CKD. BY	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER
J	6-16-11	Revised Variations	TBW	CL			5909
F	6-13-11	Revised Note	TBW	CL			
G	5-23-11	Added Note	TBW	CL			
H	10-8-09	Revised Notes	RN	CL			