

MILD CLIMATE ANTI-SIPHON SILLCOCK

FUNCTION: For installation in interior and exterior wall locations of buildings that are not subject to freezing. Vacuum breaker prevents contamination of potable water supply and conforms to the requirements of ASSE Standard 1011.

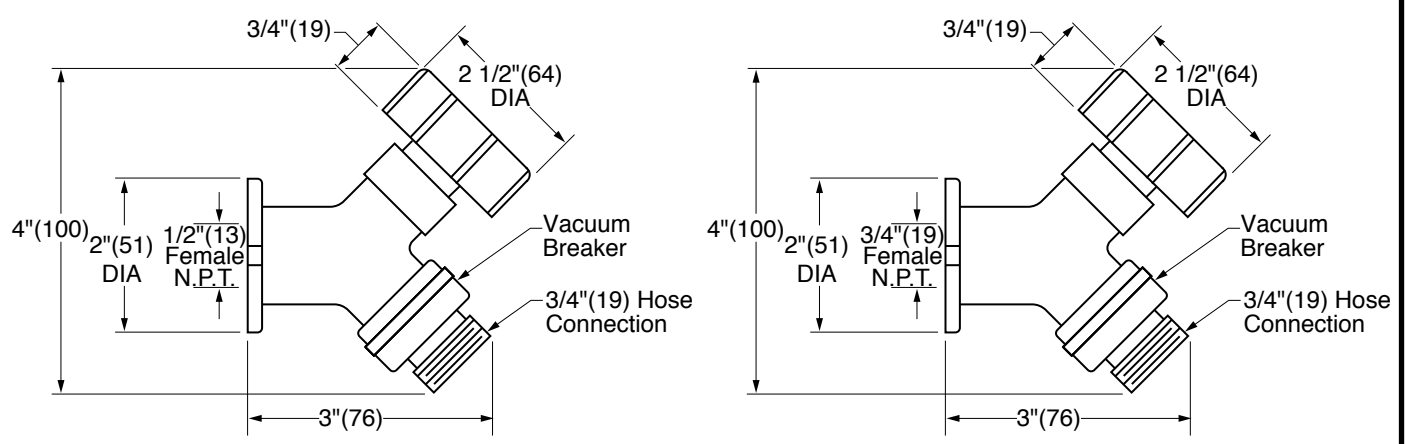


Fig. 5672 1/2"(13) Inlet

Fig. 5673 3/4"(19) Inlet

NOTES:

1. The AB1953, California Lead Law, and NSF/ANSI Standard 61-2008 - Drinking Water Components are not applicable to Jay R. Smith hydrants as they do not convey/dispense water for human consumption through drinking or cooking.
2. Dimensions shown in parentheses are in millimeters.
3. **FOR IRRIGATION PURPOSES ONLY.**

REGULARLY FURNISHED:

Hose Valve has a Rough Finish Brass Body Removable Wheel Handle, "T" Handle Key, NPT Female Threaded Inlet Size Indicated by Figure Number Selected and ASSE 1011 Vacuum Breaker with 3/4"(19) Hose Connection.

OPTIONAL MATERIALS:

Rough Chrome Plated -CP

Installer is responsible for providing a 100% watertight positive seal at the hydrant to wall interface. Seal all the flange with an appropriate sealant recommended by a sealant manufacturer. **NOTE: Jay R. Smith does not warrant the performance or life expectancy of the sealant material.**

NOTE: Dimensions shown in Parentheses are in millimeters.

DRAWING NUMBER: 5672, 5673
 SIZE: A
 SCALE: NONE
 DATE: 6-17-11
 APPROVED BY: CL
 CHECKED BY: CL
 DRAWN BY: TBW
 FIGURE NUMBER: 5672, 5673

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA
 DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

D	4-5-18	Added Notes	TBW	BW	WEIGHT	VOLUME	FIGURE NUMBER
C	5-13-14	Revised Optional Materials	TBW	CL	POUNDS	CUBIC FEET	5672, 5673
B	4-24-13	Revised Drawing	TBW	SJM			
A	2-4-13	Revised Notes	TBW	CL			
REV.	DATE	DESCRIPTION	BY	CKD. BY			